


The additional signaling module for battery charger unit Gamatronics type



In the battery charger units (BCU) type Gamatronics often repeating malfunction: burning of primary windings (400 volt) the small transformers installed on one PCB of a control system takes place. BCU ceases to functioning, but also does not give out an emergency signal about the malfunction. As a result the voltage of the battery decreases to a critical level up to the moment of arrival of the operational personnel to substation.

The additional module for signaling at burning of transformers in control system is offered.

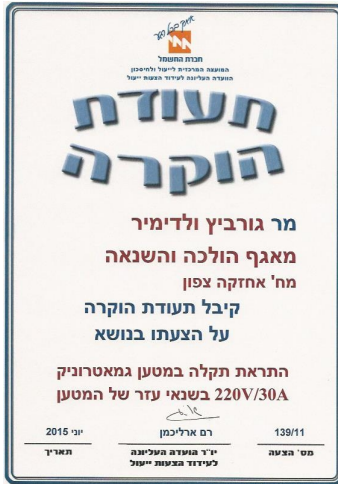